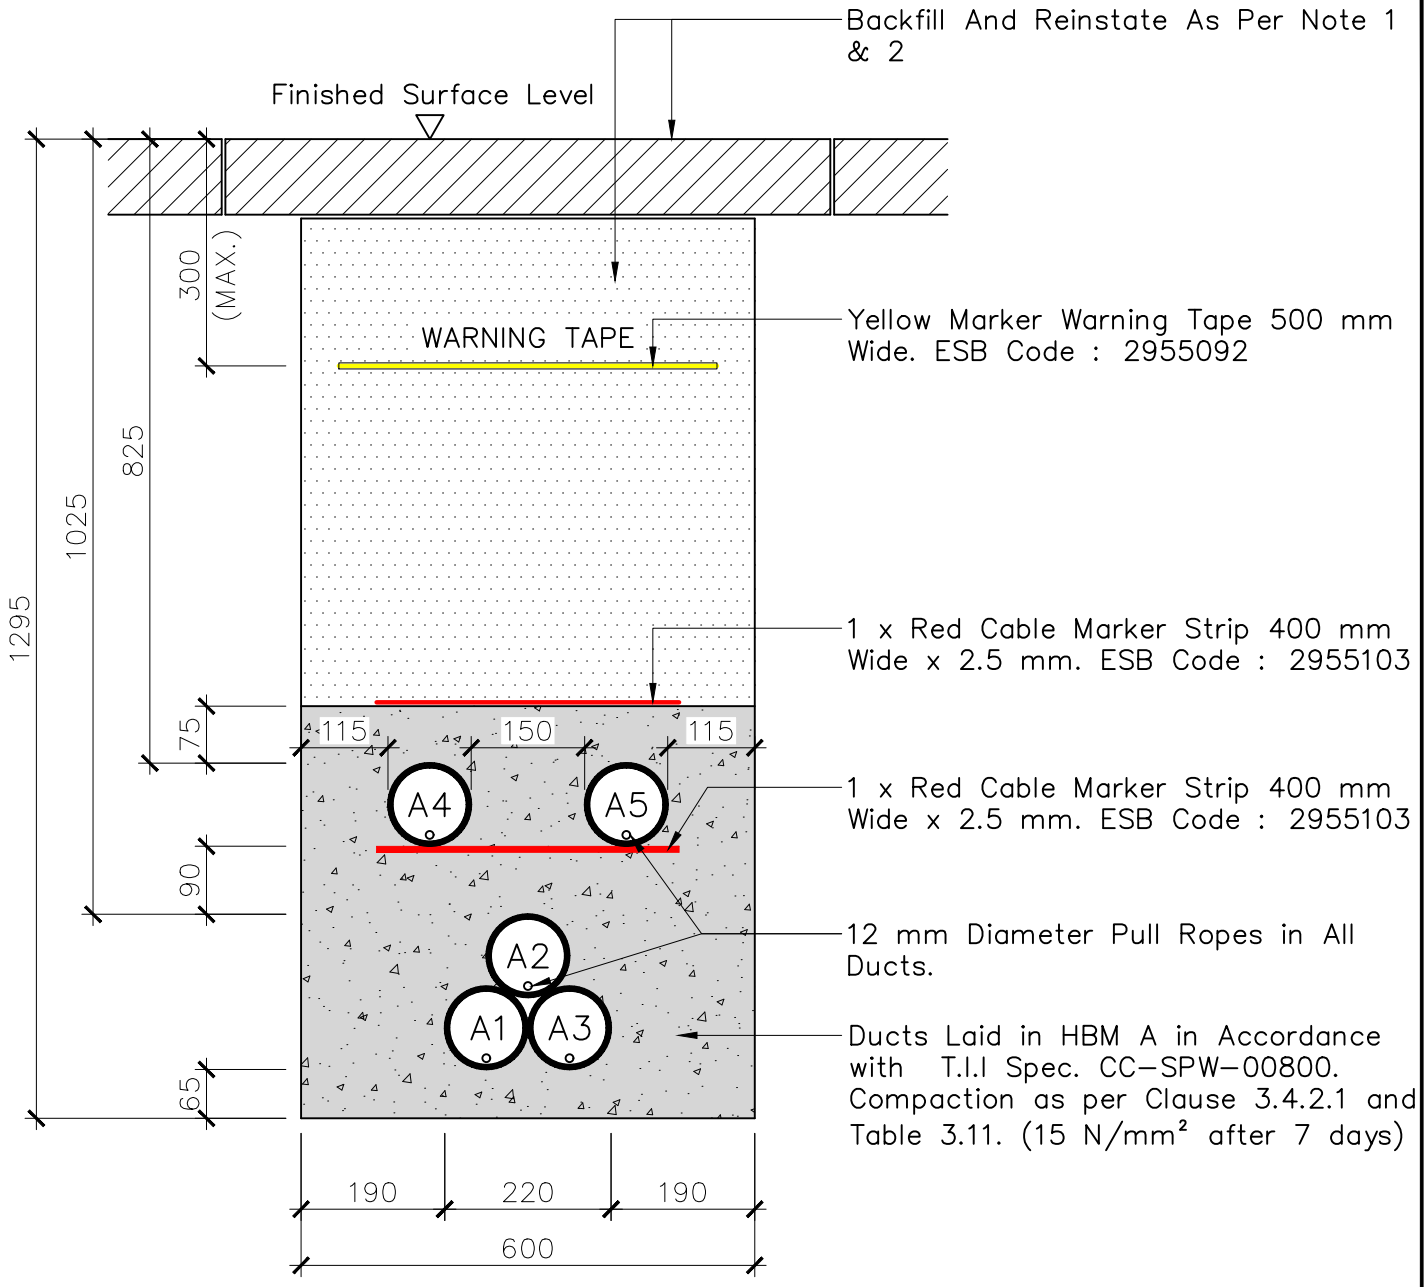


A=110 mm: Outer Diameter HDPE ESB Approved Duct, SDR=17.6
All Dimensions in Millimetres.

NOTES:

1. INSTALLATIONS WITHIN PUBLIC ROADS

BACKFILL AND REINSTATEMENT SHALL BE CARRIED OUT IN ACCORDANCE WITH THE CURRENT EDITIONS OF THE DEPARTMENT OF TRANSPORT PUBLICATIONS, "GUIDELINES FOR MANAGING OPENINGS IN PUBLIC ROADS" AND "INTERIM GUIDANCE TO ROAD AUTHORITIES REGARDING THE PROPOSED PLACEMENT OF ELECTRICITY ASSETS, INCLUDING DUCTS, CABLES AND ASSOCIATED INFRASTRUCTURE, UNDER PUBLIC ROADS."

2. NON-PUBLIC ROAD / OFF-ROAD LOCATIONS

BACKFILL AND REINSTATEMENT SHALL BE CARRIED OUT IN ACCORDANCE WITH THE REQUIREMENTS OF THE RELEVANT LANDOWNER, ASSET OWNER, STAKEHOLDER, STATUTORY AUTHORITY AND/OR PROJECT-SPECIFIC AGREEMENT, AS APPLICABLE.

DOC-090217-CMY

Rev	Date	Revision description	Drn.	Prod.	Ver.	App
6		REINSTATEMENT DETAILS REVISED				
5	24.09.25	ADDITION OF ONESOURCE NUMBER	EM	EM	OC	JM
4	16.09.25	DISTANCE TO TOP OF DUCTS INCREASED BY 75 mm	EM	EM	OC	JM
3	20.05.25	REFERENCE TO CBGM UPDATED TO NEW T.I.I SPECIFICATION	KD	KD	JM	PoN
2	22.08.21	NOTE REMOVED	KD	KD	JM	RD
1	28.01.21	ESB NAME AND ADDRESS UPDATED, TRENCH DEPTH REVISED	RK	RK	MA	RD
0	06.11.15	ISSUED FOR CONSTRUCTION	GR	GR	MA	TS

Purpose of issue – Preliminary unless indicated
Client Approval ☐ Planning ☐ Tender ☐ Construction ☒ As-built ☐

Energy for generations
Engineering and Major Projects,
The Sidings, Grand Canal Quay,
Dublin 2, D02 E7K8, Ireland.
Tel: +353 (0) 1 703 8000 Web: www.esb.ie
Engineering and Major Projects is a division of ESB

COPYRIGHT © ESB
ALL RIGHTS RESERVED. NO PART OF THIS WORK MAY BE MODIFIED, REPRODUCED OR COPIED IN ANY FORM OR BY ANY MEANS – GRAPHIC, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, TAPING OR USED FOR ANY PURPOSE OTHER THAN ITS DESIGNATED PURPOSE, WITHOUT THE WRITTEN PERMISSION OF ESB.

Drawn	Produced	Verified	Approved	Approval Date
E.Mans	E.Mans	O.Canty	J.Martin	03/11/2026

Client ref.	No. of sheets	Size	Scale
TC216203	1	A4	1:10

Client: ESB NETWORKS

Project: 38 kV Cables Standards

Contract: 38 kV CABLE STANDARDS

Production unit: HV Linear Assets Delivery

Drawing title: TRENCH CROSS SECTION
38 kV SINGLE CIRCUIT
110 mm TREFOIL – 5 WAY

Drawing number: PE424-D7003-004-003-006

Sheet

Rev

c:\bc-workspace\mans_e\m-virtapp2349s.cld1.tld.int,d-high voltage\drawings\pe424 hv cables\7003 - 38 kv cables standards\pe424-d7003-004-003-006.dwg