


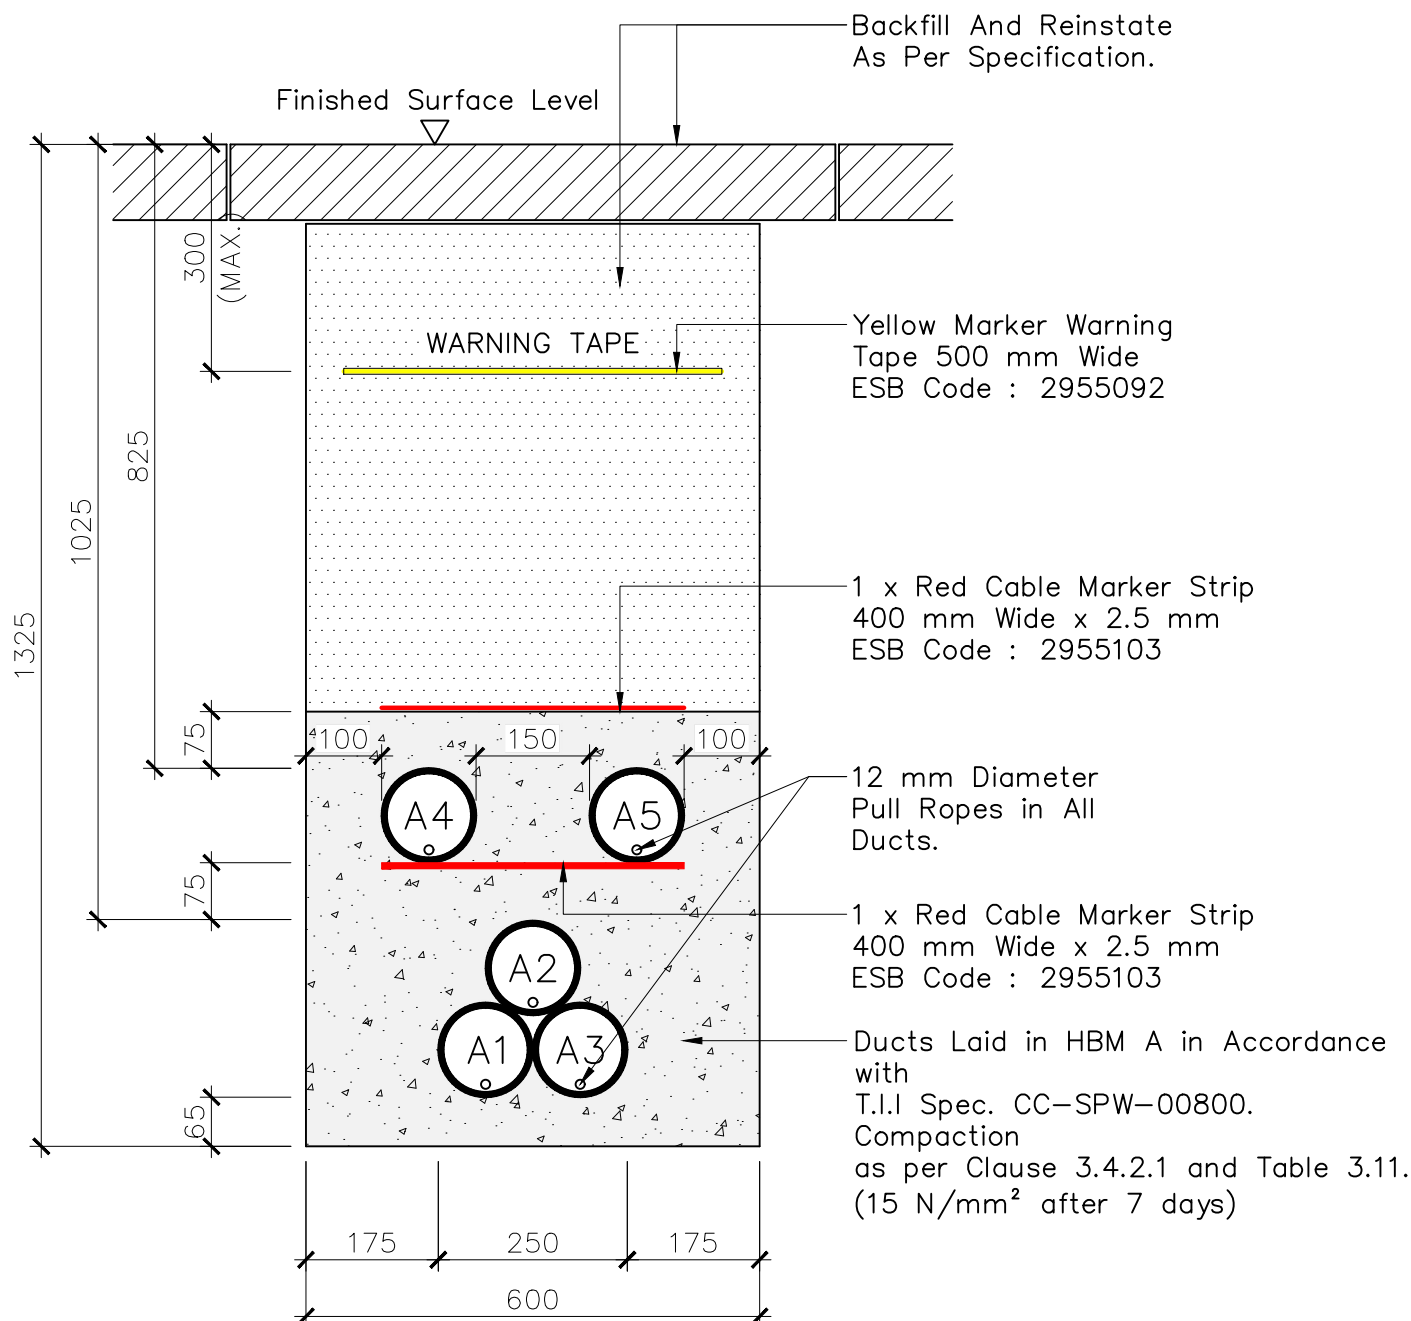

A=125 mm: Outer Diameter HDPE ESB Approved Duct, SDR=17.6
All Dimensions in Millimetres.

DOC-090217-CMY

 Engineering and Major Projects, One Dublin Airport Central, Dublin Airport, Cloghran, Co. Dublin, K67 XF72, Ireland. Tel: +353 (0)1 703 8000 Web: www.esb.ie Engineering and Major Projects is a division of ESB.	2 ADDITION OF ONESOURCE NUMBER		1 16.09.26 DISTANCE TO TOP OF DUCTS INCREASED BY 75 mm E.M. E.M. O.C. J.M.		0 18.08.25 INITIAL REVISION K.D. K.D. J.M. P.M.	
	Rev. Date Revision description Dm, Prod, Ver, App		Purpose of issue – Preliminary unless indicated		Client Approved ☐ Planning ☐ Tender ☐ Construction ☒ As-built ☐	
	Client ESB NETWORKS		Project 38 kV Cables Standards		Drawing title TRENCH CROSS SECTION 38 kV SINGLE CIRCUIT 125 mm TREFOIL – 5 WAY	
	Contract CABLE SERVICES TO ESB		Production unit Transmission and Distribution Delivery		Drawing number PE424-D7003-012-001-002	

Copyright © ESB ALL RIGHTS RESERVED. NO PART OF THIS WORK MAY BE MODIFIED, REPRODUCED OR COPIED IN ANY FORM OR BY ANY MEANS – GRAPHIC, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, TAPING OR USED FOR ANY PURPOSE OTHER THAN ITS DESIGNATED PURPOSE, WITHOUT THE WRITTEN PERMISSION OF ESB.				
Drawn E.Mans	Produced E.Mans	Verified O.Canty	Approved J.Martin	Approval Date 24/09/2026
Client ref. TC234354	No. of sheets 1	Size A4	Scale 1:10	